


EYD SEAL FITTINGS (TRADE SIZES 7 – 0)

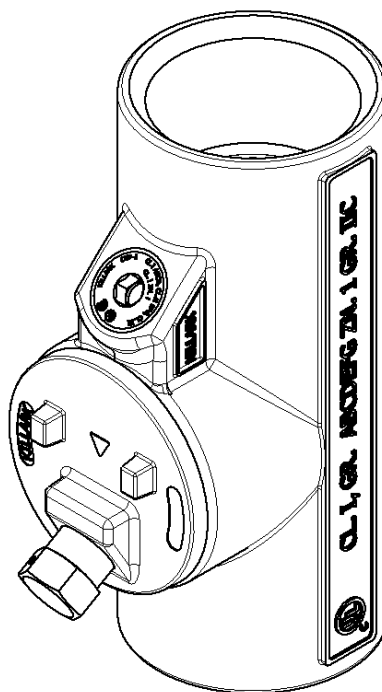

CATALOG NO.	c UL us Ratings
EYD-7 (M)	CL. I, GR. CDEFG ZN. 1 GR. IIB
EYD-8 (M)	CL. I, GR. CDEFG ZN. 1 GR. IIB
EYD-9 (M)	CL. I, GR. CDEFG ZN. 1 GR. IIB
EYD-0 (M)	CL. I, GR. CDEFG ZN. 1 GR. IIB

CAUTION:

Before installing, make sure you are compliant with area classifications, as failure to do so may result in bodily injury, death and property damage. Do not attempt installation until you are familiar with the following procedures. All installation must comply with the applicable Electrical Code(s). Make sure that the circuit is de-energized before starting installation or maintenance. Verify that the installation is grounded. Failure to ground will create electrical shock hazards, which can cause serious injury and or death.

IMPORTANT:

Please read these instructions carefully before installing or maintaining this equipment. Good electrical practices should be followed at all times and this data should be used as a guide only.

Technical information, advice and recommendations contained in these documents is based upon information that Killark believes to be reliable. All the information and advice contained in these documents is intended for use only by persons having been trained and possessing the requisite skill and know-how and to be used by such persons only at their own discretion and risk. The nature of these instructions is informative only and does not cover all of the details, variations or combinations in which this equipment may be used, its storage, delivery, installation, check out, safe operation and maintenance. Since conditions of use of the product are outside of the care, custody and control of Killark, the purchaser should determine the suitability of the product for his intended use, and assumes all risk and liability whatsoever in connection there with.

PREPARING EYD SEALING FITTING

1. Use Killark "PF" Packing Fiber to build a dam at bottom conduit hub (see Image 1). Use a wooden stick to force the wires apart and pack the fiber tightly around all wires. The dam must be tight and strong enough to keep the sealing compound from leaking out before it sets up. The completed dam should be even with the conduit stops as shown.
2. Fully install cap (4) into seal fitting then back off no more than 1 full turn until arrow on the cap is pointing down (see Image 2).
3. For EYD installations coat the plastic tubing and the threads of the plastic thread protector in the drain hole. Then push the tubing into the thread protector until the top end is even with the bottom of the threads, as shown in Image 1.
4. When the sealing compound has cured (See Mixing & Cure Times) pull the plastic tubing out with a pair of pliers and unscrew the plastic thread protector. Install the KDB-1 drain and tighten it firmly.

MIXING AND CURE TIMES

5. When using Killark Type "SC" Sealing Compound, mix the sealing compound with water at a rate of 3.3 parts of compound to 1 part water by volume (4 to 1 by weight). Use a clean mixing vessel for each batch. Sprinkle the sealing compound into water while stirring; continue mixing for at least 3 MINUTES. The proper consistency is just fluid enough to pour SLOWLY, like thick gravy (NOT WATERY) and should have a smooth silky shimmer in appearance when mixed correctly. Do not mix more material than can be poured in 15 minutes. Discard any sealing compound that has become too stiff to use. Never attempt to restore workability by stirring in more water. After the compound is mixed properly, slowly pour it into the sealing fitting. Make sure the wires are separated so the compound will completely surround them. Pour slowly to avoid trapping air bubbles in the compound and fill to the required level shown in Table 1.

CAUTION: FOR GROUPS C & D

Sealing compound to be mixed at a temperature no lower than 40°F/4°C and ONLY poured into fittings that have been brought to a temperature of 40°F/4°C. Seals must NOT be exposed to temperatures below 40°F/4°C for at least 8 hours.

CATALOG NO.	CONDUIT SIZE	POUR DEPTH (MIN.)	REQUIRED AMOUNT MIXED (OZ.)	c UL us Ratings
EYD-7 (M)	2 ½"	3 13/32"	15.8	CL. I, GR. CDEFG ZN. 1 GR. IIB
EYD-8 (M)	3"	4 1/8"	26.3	CL. I, GR. CDEFG ZN. 1 GR. IIB
EYD-9 (M)	3 ½"	4 3/4"	38.6	CL. I, GR. CDEFG ZN. 1 GR. IIB
EYD-0 (M)	4"	5 1/8"	54.2	CL. I, GR. CDEFG ZN. 1 GR. IIB

TABLE 1

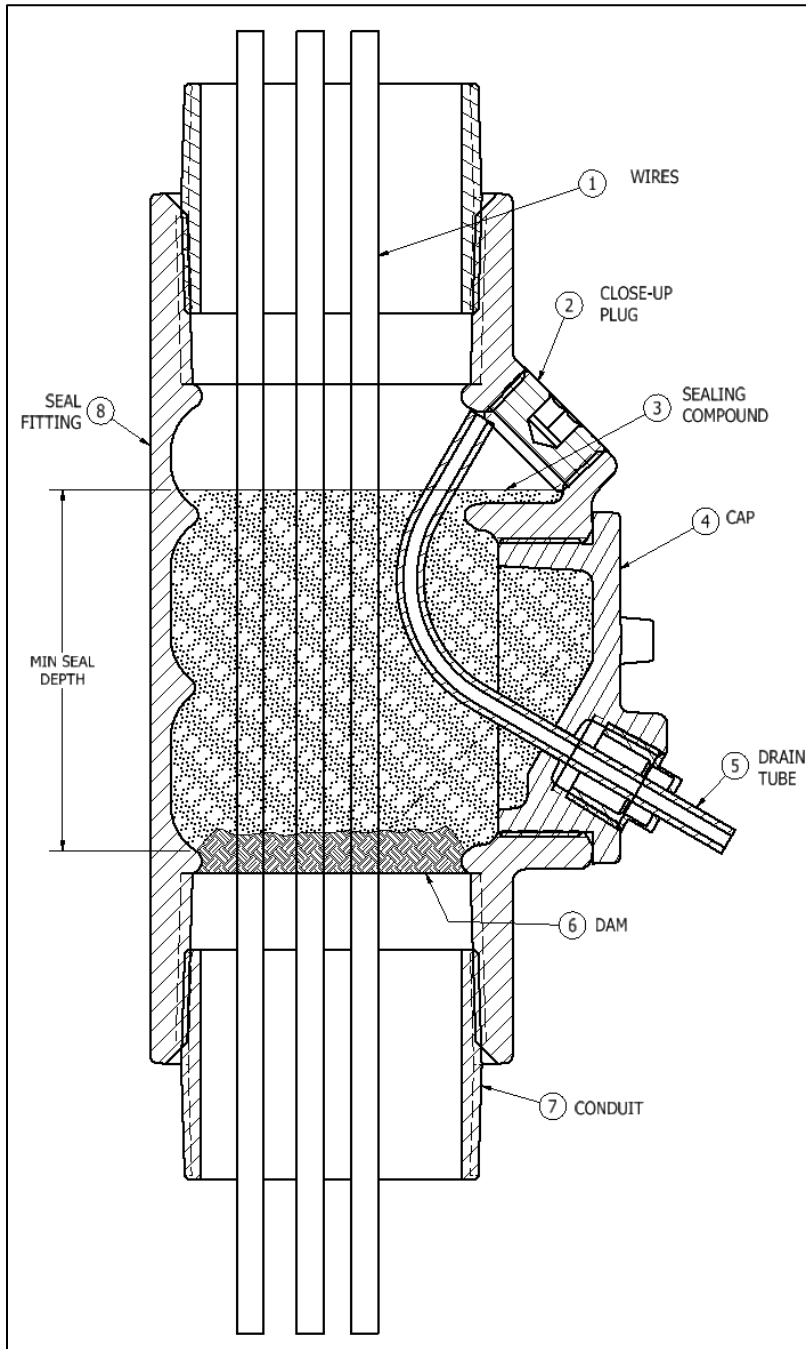


IMAGE 1

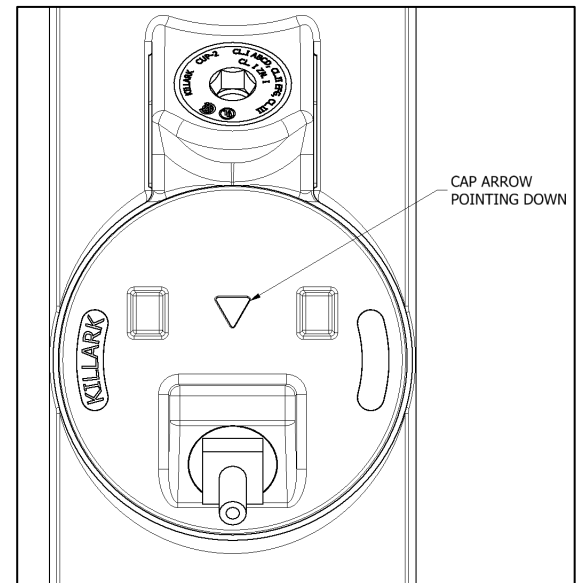


IMAGE 2

**RECOMMENDED MAXIMUM NUMBER OF WIRES
THAT CAN BE PROPERLY SEALED IN A SEALING FITTING IN THE FIELD**

The maximum number of wires ^{a,b} that can be sealed in a sealing fitting are as follows:																									
Size AWG or kcmil	1/2 Inch 16 Metric Design- ator		3/4 Inch 21 Metric Design- ator		1 Inch 27 Metric Design- ator		1-1/4 Inch 35 Metric Design- ator		1-1/2 Inch 41 Metric Design- ator		2 Inch 53 Metric Design- ator		2-1/2 Inch 63 Metric Design- ator		3 Inch 78 Metric Design- ator		3-1/2 Inch 91 Metric Design- ator		4 Inch 103 Metric Design- ator		5 Inch 129 Metric Design- ator		6 Inch 155 Metric Design- ator		
	A	B	A	B	A	B	A	B	A	B	A	B	A	B	A	B	A	B	A	B	A	B	A	B	
18	7	11	12	20	12	20	20	33	35	58	49	80	80	131	115										
16	6	9	10	16	17	27	17	27	30	47	41	64	68	106	98										
14	3	8	6	15	10	24	10	24	18	43	25	58	41	96	58		90		121						
12	3	6	5	11	8	18	8	18	15	32	21	43	34	71	50	102	76		103						
10	1	4	4	7	7	11	13	20	13	20	20	27	29	45	41	65	64	100	86	134	110				
8	1	2	2	4	4	6	7	11	9	16	9	16	16	26	22	37	35	58	47	78	60	100	94		
6	1	1	1	2	2	4	4	7	6	9	10	16	15	23	15	23	23	35	32	47	41	61	64	96	
4	1	1	1	1	1	2	3	4	5	6	8	9	12	14	18	21	18	21	24	29	31	37	49	59	
3			1	1	1	2	3	3	4	5	7	8	10	12	16	18	16	18	21	24	28	31	44	50	
2			1	1	1	1	3	3	3	4	6	7	9	10	14	15	14	15	19	20	24	26	38	42	
1			1	1	1	1	1	2	3	3	4	5	7	7	10	11	10	11	14	15	18	20	29	31	
0					1	1	1	2	2	2	4	4	6	6	9	9	12	13	12	13	16	16	25	26	
2/0					1	1	1	1	1	2	3	3	5	5	8	8	11	11	14	14	14	14	22	22	
3/0					1	1	1	1	1	1	3	3	4	4	7	7	9	9	12	12	12	12	19	19	
4/0							1	1	1	1	2	2	3	3	6	6	8	8	10	10	10	10	16	16	
250							1	1	1	1	1	2	3	3	5	5	6	6	8	8	11	11	15	15	
300							1	1	1	1	1	1	3	3	4	4	5	5	7	7	10	10	15	15	
350							1	1	1	1	1	1	1	2	3	3	5	5	6	6	10	10	14	14	
400									1	1	1	1	1	2	3	3	4	4	6	6	9	9	13	13	
500									1	1	1	1	1	1	3	3	4	4	5	5	8	8	11	11	
600											1	1	1	1	1	2	3	3	4	4	6	6	9	9	
700											1	1	1	1	1	2	3	3	3	3	6	6	8	8	
750											1	1	1	1	1	1	3	3	3	3	5	5	8	8	
800											1	1	1	1	1	1	2	2	3	3	5	5	7	7	
900											1	1	1	1	1	1	2	3	3	4	4	7	7		
1000											1	1	1	1	1	1	1	3	3	4	4	6	6		
1250													1	1	1	1	1	1	2	3	3	5	5		
1500															1	1	1	1	1	3	3	4	4		
1750															1	1	1	1	1	2	2	4	4		
2000															1	1	1	1	1	1	3	3			

^a Col. A = Types RFH-2, RH, RHH, RHW, THW, TW, XHHW (AWG 14– 6), FEPB (AWG 6 – 2)

Col. B = FEP, THHN, THWN, TFN, PF, PGF, XHHW (AWG 4 – 2000 kcmil), FEPB (AWG 14 – 8)

^b Any combination of these wires not exceeding 25 percent of a cross section of the conduit for the fitting they fill may be used.