


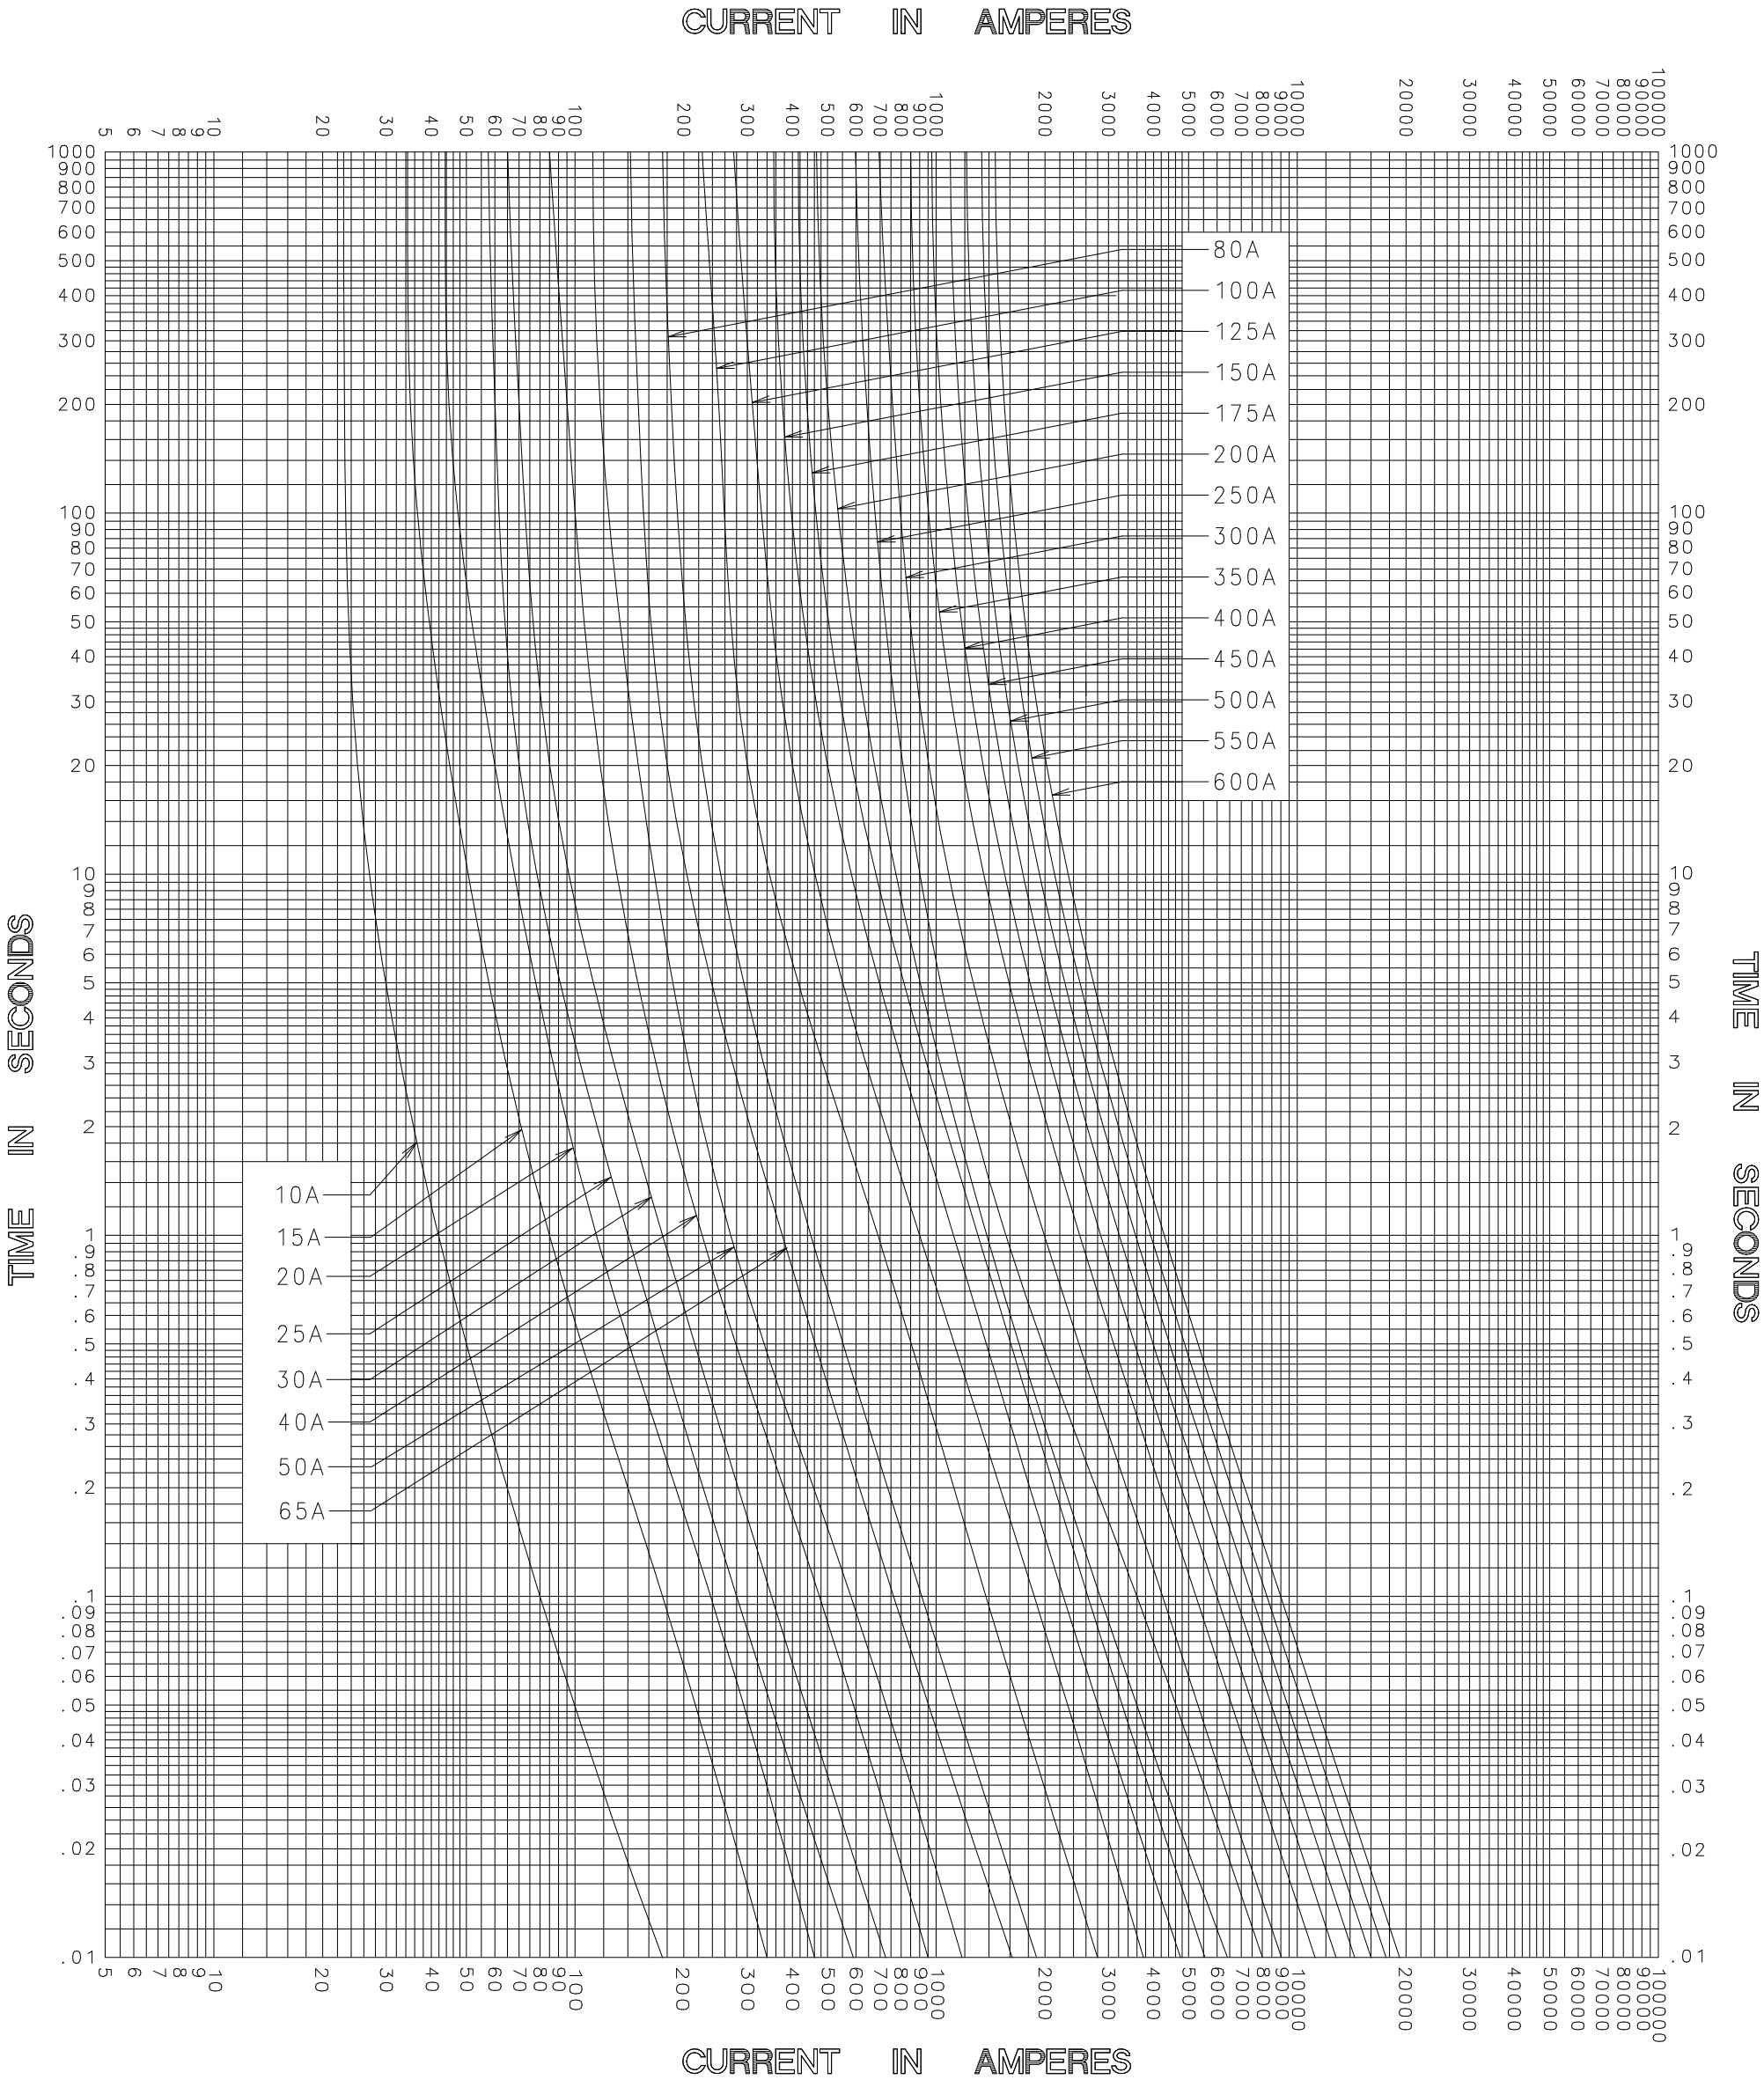

CLEARING TIME CURRENT CHARACTERISTIC CURVES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER 5.5kV E-RATED 10E-600E
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>07/23/04</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>B-FCC05.5E-6001</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT