
REVISION		
REV	DATE	DESCRIPTION
A	12/22/2009	Value

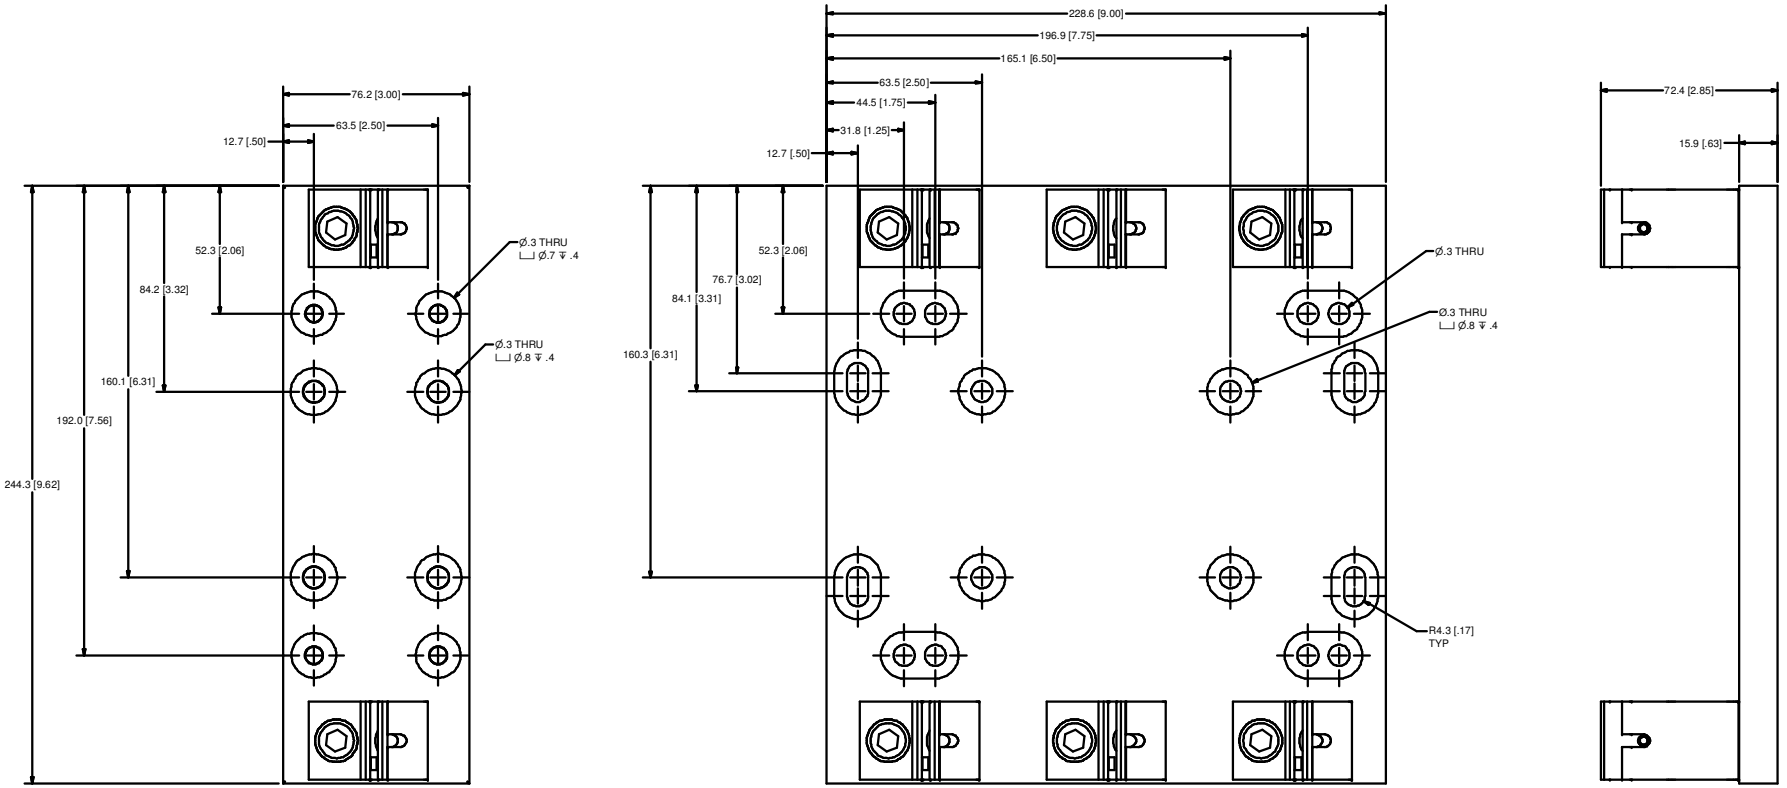

SPECIFICATIONS:

VOLTAGE RATING: 600V

AMPERE RATING: 200 AMPERES

INTERRUPT RATING: 10kA

TERMINAL TYPE: BOX LUG

SUGGESTED TORQUE: 31.1 N-m (275 IN-LBS)

WIRE RANGE: 250kcmil-6 AWG Cu/Al
SOLID/STRANDED

APPROVALS: UL LISTED (FILE NO. E14721)
CSA CERTIFIED (FILE NO. LR73091)

●	DENOTES CRITICAL CHARACTERISTICS.
CPK	DENOTES CPK DIMENSIONS, -MINIMUM CPK VALUE
(ST)	DENOTES A CHARACTERISTIC THAT PROVIDES AN INDICATION OF PROCESS PERFORMANCE. PROCEDURE FOR MEASUREMENT AND TRACKING TO BE DEFINED IN LITTELFUSE INSPECTION INSTRUCTIONS.
CP	DENOTES CP DIMENSIONS, -MINIMUM CP VALUE MUST BE WITHIN THE DIMENSIONAL LIMITATIONS SHOWN ON DRAWING AND INITIALLY LOCATED TO ALLOW FOR MAXIMUM TOOL LIFE.

MATL SPEC		FINISH	
DRW	DATE	SCALE	FINISH GOOD WT
M. York	2/11/2010	NTS	GRAMS/PIECE

UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE IN MILLIMETERS, DIMENSIONS IN BRACKETS [ ] ARE INCHES DIMENSIONING AND DO NOT INCLUDE PLATING. TOLERANCING TO BE INTERPRETED IN ACCORDANCE WITH ANSI Y14.5M-1994

3RD ANGLE PROJECTION

TITLE: LFH60200 OUTLINE

Littelfuse
DES PLAINES, ILLINOIS 60016

REVISION	DRWG NO.	SHEET 1 OF 1
A	OL-LFH60200 Series	