


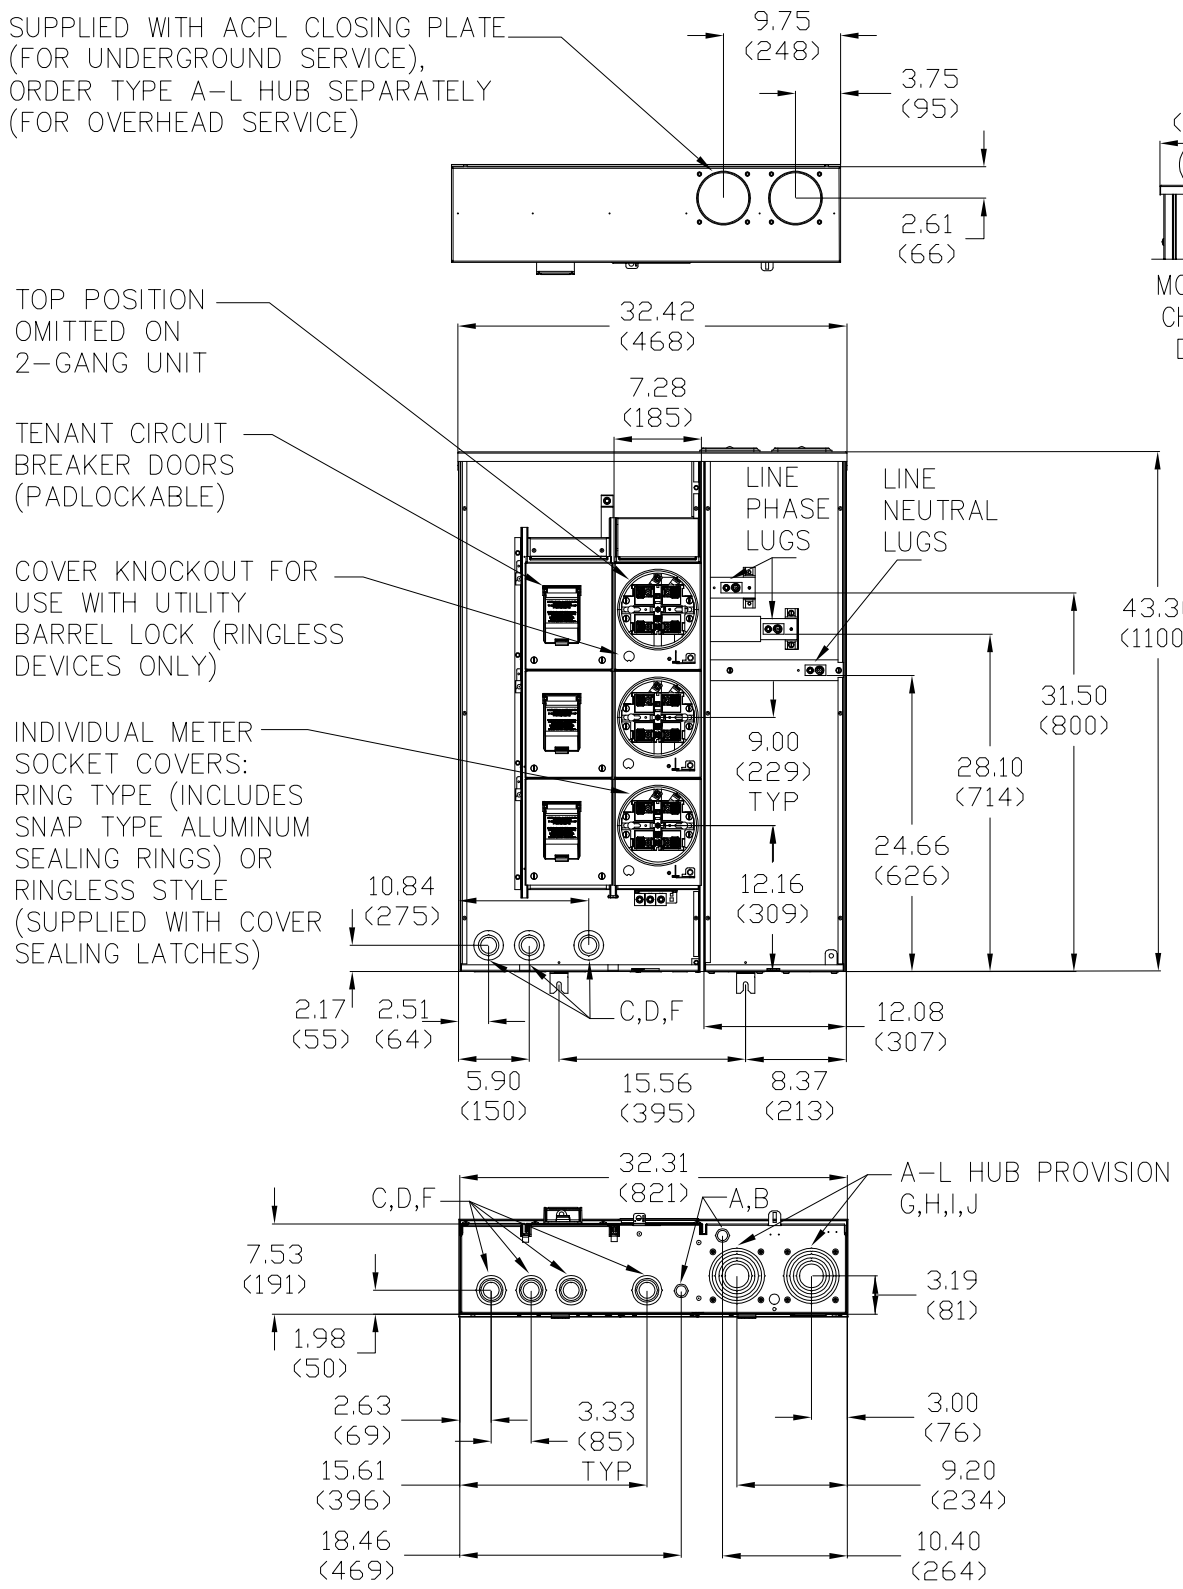




TENANT SERVICE DISCONNECTS (ORDER ONE PER SOCKET POSITION)			
TENANT CIRCUIT BREAKER CATALOG DESIGNATION (2-POLE)	CURRENT RATING AMPERES MIN – MAX	SHORT CIRCUIT BREAKER RATING RMS SYMMETRICAL AMPERES MAX▲	VOLTS MAX
QBP-TM	70 – 125	10,000	240
QDP-TM	70 – 125	25,000	
QGP-TM	70 – 125	65,000	
QJP-TM	70 – 125	100,000	

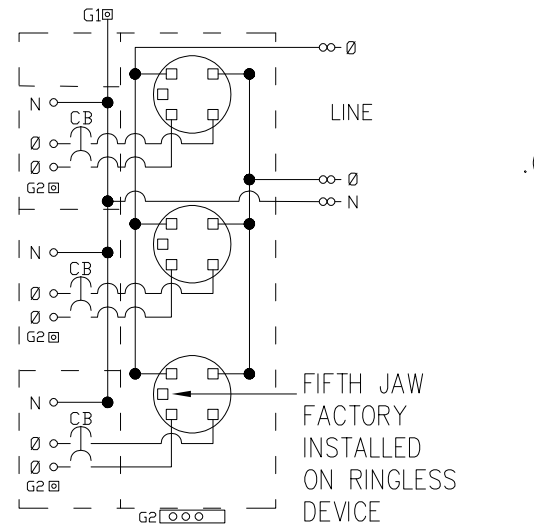


G1 – Service Ground Electrode Conductor
G2 – Equipment Grounding

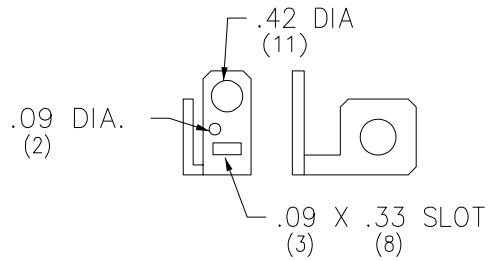


RINGLESS COVER LATCH

KNOCKOUTS				
SYMBOL	CONDUIT SIZE		HOLE DIAMETER	
	IN	MM	IN	MM
A	.50	13	.88	22
B	.75	19	1.25	32
C	1.00	25	1.38	35
D	1.25	32	1.75	44
E	1.50	38	2.00	51
F	2.00	51	2.50	64
G	2.50	64	3.00	76
H	3.00	76	3.63	92
I	3.50	89	4.13	105
J	4.00	102	4.63	118

‡ ALTERNATE MECHANICAL LUGS	
WIRE SIZE	CATALOG NO.
(1) 1/0-600 AWG/KCMIL OR (2) 1/0-250 PER PHASE	MMLK250
(2) 3/0-500 AWG/KCMIL PER PHASE	MMLK500
(2) 2-600 AWG/KCMIL PER PHASE	MMLK600

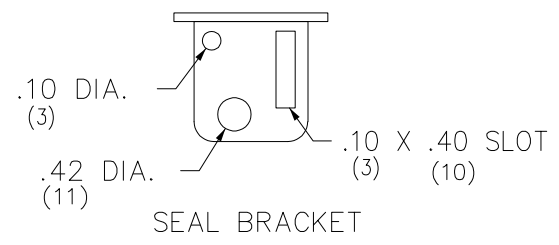

SEAL BRACKET

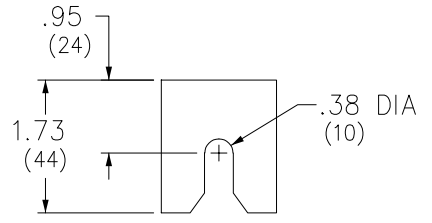

MOUNTING FOOT

DUAL DIMENSIONS: INCHES (MILLIMETERS)

METER SOCKET COVER	NO. OF METER SOCKETS	NO. OF JAWS	FACTORY INSTALLED BYPASS	120/240VAC, 1ø3W OR 120/208 VAC, 1ø3W (DERIVED FROM A 208Y/120 VAC, 3ø4W NETWORK) (5TH JAW REQUIRED)			LOAD LUG WIRE SIZES (AWG-KCMIL)		
				MAIN BUS RATING	CATALOG NUMBER	LINE LUG WIRE SIZES (AWG/KCMIL) PHASE AND NEUTRAL	PHASE■	NEUTRAL, SERVICE GROUND & CONVENIENCE EQUIPMENT GROUNDING	EQUIPMENT GROUNDING
RING-TYPE	3	4	NONE	300	MPC33125	(1) 1/0-600 OR (2) 1/0-250	SEE CIRCUIT BREAKER WIRE SIZE	4-300 CU/AL	2/0-14 CU, 2/0-12 AL
RINGLESS	3	5	NONE	300	MPCR33125				
RINGLESS	3	5	HORN	300	MPCH33125				

NOTES:
FINISH – UL COMPONENT RECOGNIZED GRAY BAKED POWDER COAT PAINT OVER GALVANNEALED STEEL.
UL LISTED – FILE E-6294. SUITABLE ONLY FOR USE AS SERVICE EQUIPMENT. SUITABLE FOR OH/UG SERVICE.
RING-TYPE DEVICE SUPPLIED WITH 4-JAW METER SOCKET, 5TH JAW KIT AVAILABLE.
▲ SHORT CIRCUIT CURRENT RATING OF METER CENTER IS EQUAL TO THE RATING OF THE LOWEST INSTALLED TENANT SERVICE DISCONNECT.
■ LOAD PHASE LUGS ARE SUPPLIED AS A PART OF THE CIRCUIT BREAKER (TENANT SERVICE DISCONNECT).
SURFACE MOUNT.
MECHANICAL LUGS FACTORY INSTALLED, LUG LANDING PADS AVAILABLE.
‡ LUGS LARGER THAN 600 KCMIL REQUIRE USE OF LUG LANDING PADS (ORDER CATALOG NUMBER MMSK2 SEPARATELY).
THIS DEVICE MEETS UL & NEC LATEST REQUIREMENTS FOR SERVICE DISCONNECT COMPARTMENTALIZATION.

MP METER-PAK COMPARTMENTALIZED
DISCONNECT METERING EQUIPMENT
UL TYPE 3R ENCLOSURE
125A MAXIMUM TENANT SERVICE DISCONNECT

SQUARE D COMPANY

DWG. NO. —

JANUARY 2026

REF DWG #-